


PLAN VIEW

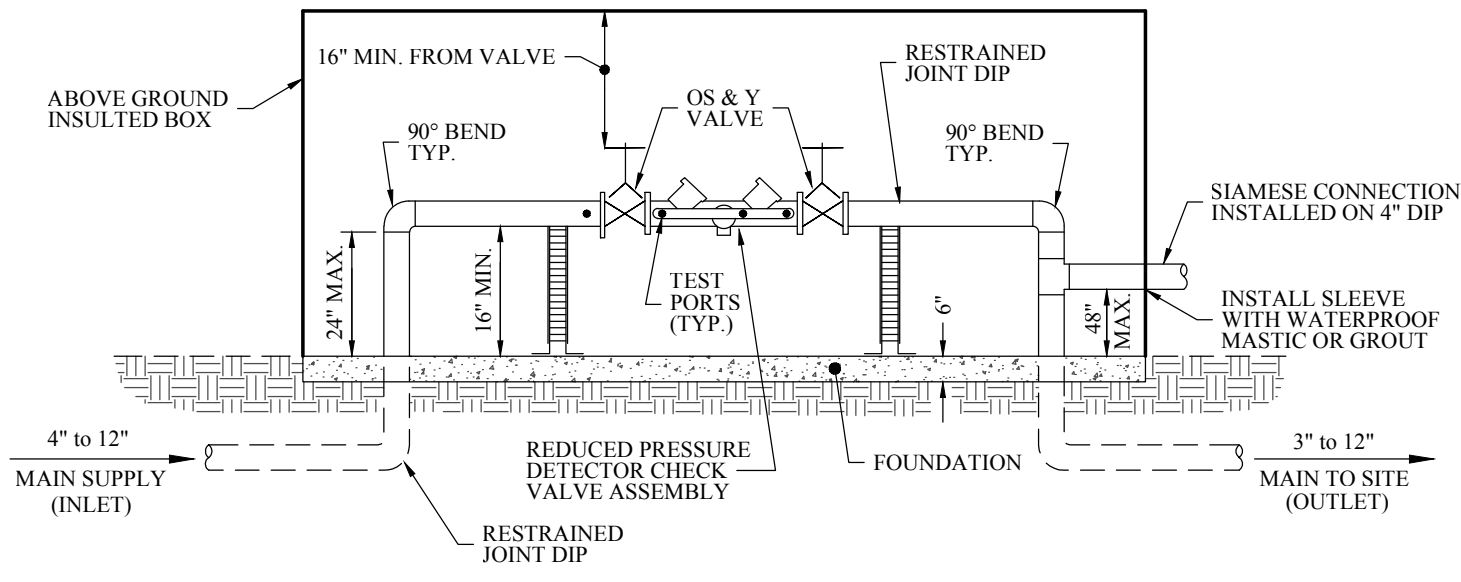

PROFILE VIEW

NOTE:  
SEE DETAILS 5.6 & 5.7.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

REVISED: JANUARY 2018

**REDUCED PRESSURE DETECTOR CHECK VALVE ASSEMBLY FIRE LINE ABOVE GROUND ENCLOSURE**  
**AUD DETAIL 1.20.4**

**AUGUSTA UTILITIES DEPARTMENT**  
**452 WALKER STREET, SUITE 200**  
**AUGUSTA, GA 30901**

