


NOTE: ALL FIRE HYDRANTS TO BE PAINTED YELLOW. PROVIDE 3' RADIUS CLEARANCE AROUND FIRE HYDRANT.

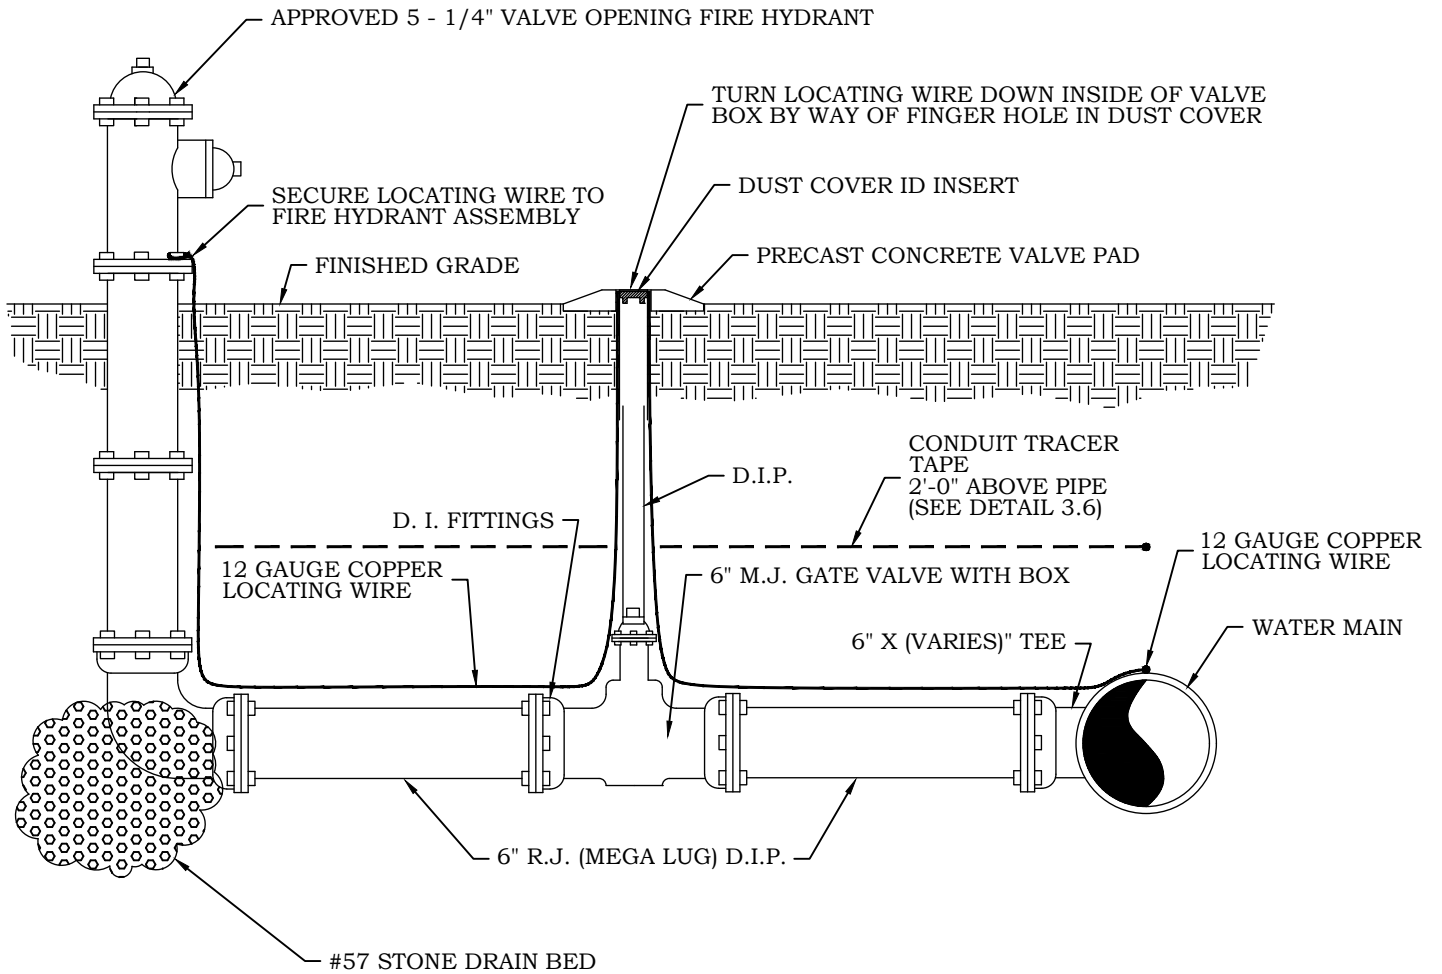

**PROFILE VIEW**

NOTES:

1. ONLY ONE (1) FIRE HYDRANT RISER BARREL WILL BE ALLOWED UNLESS OTHERWISE APPROVED BY AUD.
2. CONTRACTOR TO COORDINATE LOCATION OF VALVE WITH AUD INSPECTOR.
3. ALL PIPING SHALL BE RESTRAINED JOINT MEGA LUG.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

**APPROVED JAN. 2021**

REVISED: JANUARY 2021

**FIRE HYDRANT ASSEMBLY**

**AUD DETAIL 1.2**

**AUGUSTA UTILITIES DEPARTMENT  
452 WALKER STREET, SUITE 200  
AUGUSTA, GA 30901**

