


PLAN VIEW

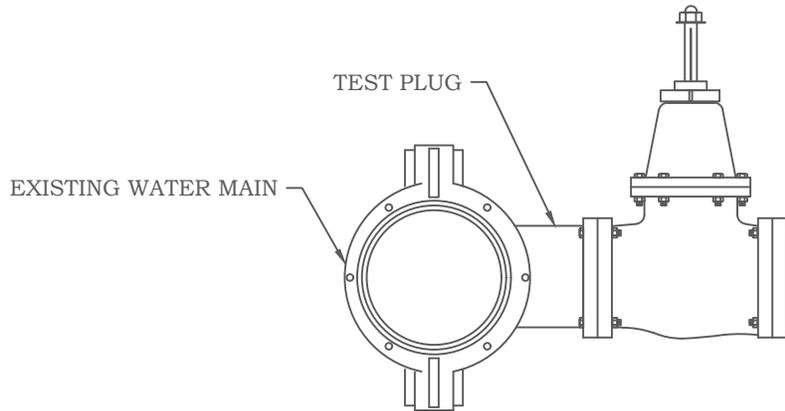

PROFILE VIEW

NOTES:

1. TAPPING VALVE SHALL BE A FULL BODY DUCTILE IRON MUELLER T-2360 RESILIENT WEDGE GATE VALVE MJ X FL ENDS (6"-12"), MUELLER T-2361 RESILIENT WEDGE GATE VALVE MJ X FL (14"-48") OR APPROVED EQUAL.
2. TAPPING SLEEVE SHALL BE A MUELLER H-615 FOR SIZES 6" - 24", & MUELLER T-9 MJ FOR 30" AND 36".
3. SS REPAIR CLAMPS AND MJ SPLIT SLEEVES WILL NOT BE ACCEPTED.
4. TAPPING VALVE SHALL BE PRESSURE TESTED FOR ONE HOUR PRIOR TO TAPPING EXISTING MAIN.
5. AN AUD INSPECTOR SHALL BE PRESENT DURING TESTING.
6. ALL TESTING SHALL BE IN ACCORDANCE WITH AUD SPECIFICATIONS.
7. TESTING PRESSURE SHALL BE 150 PSI FOR ASBESTOS CONCRETE PIPE AND 200 PSI FOR ALL OTHER PIPE MATERIALS.
8. VALVES SHALL OPEN LEFT, BLACK NUT, IF INSTALLED SOUTH OF GORDON HWY AND OPEN RIGHT, RED NUT, IF INSTALLED NORTH OF GORDON HWY.
9. TAPPING VALVE AND SLEEVE TO BE ADEQUATELY SUPPORTED.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

APPROVED JAN. 2020

REVISED: JANUARY 2018

TAPPING VALVE AND SLEEVE

**AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901**

AUD DETAIL 1.7

