


PLAN VIEW

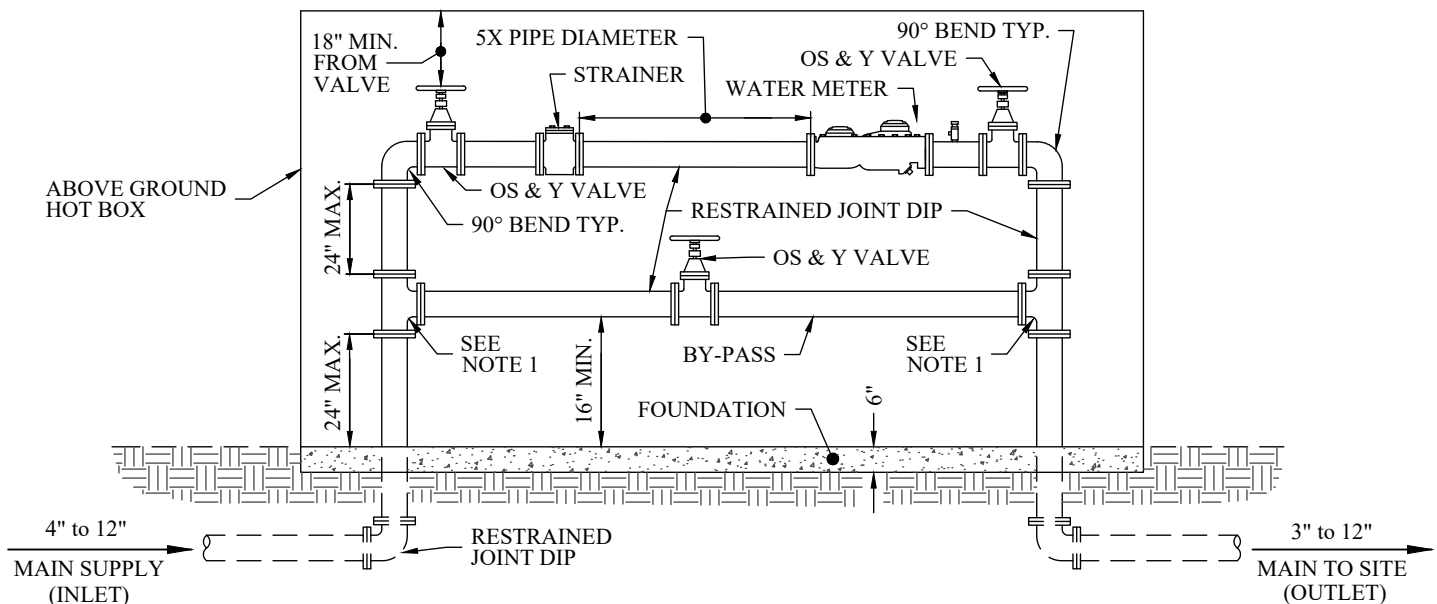

PROFILE VIEW

NOTES:

1. ALL FITTINGS INSIDE OF BOX /VALUT SHALL BE FLANGED FITTINGS.
2. DISTANCE BETWEEN THE VALVE AND STRAINER ON INLET SIDE AND BETWEEN THE METER AND VALVE ON DISCHARGE SIDE SHALL BE 5X DIAMETER OF PIPE.
3. SEE DETAILS 1.22 & 1.23.
4. ENSURE 18" MINIMUM DISTANCE IS MEASURED FROM WHEEL TO THE TOP OF THE BOX.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

APPROVED JAN. 2021

REVISED: JANUARY 2021

**WATER METER
ABOVE GROUND ENCLOSURE**

AUD DETAIL 1.12

**AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901**

