


PLAN VIEW

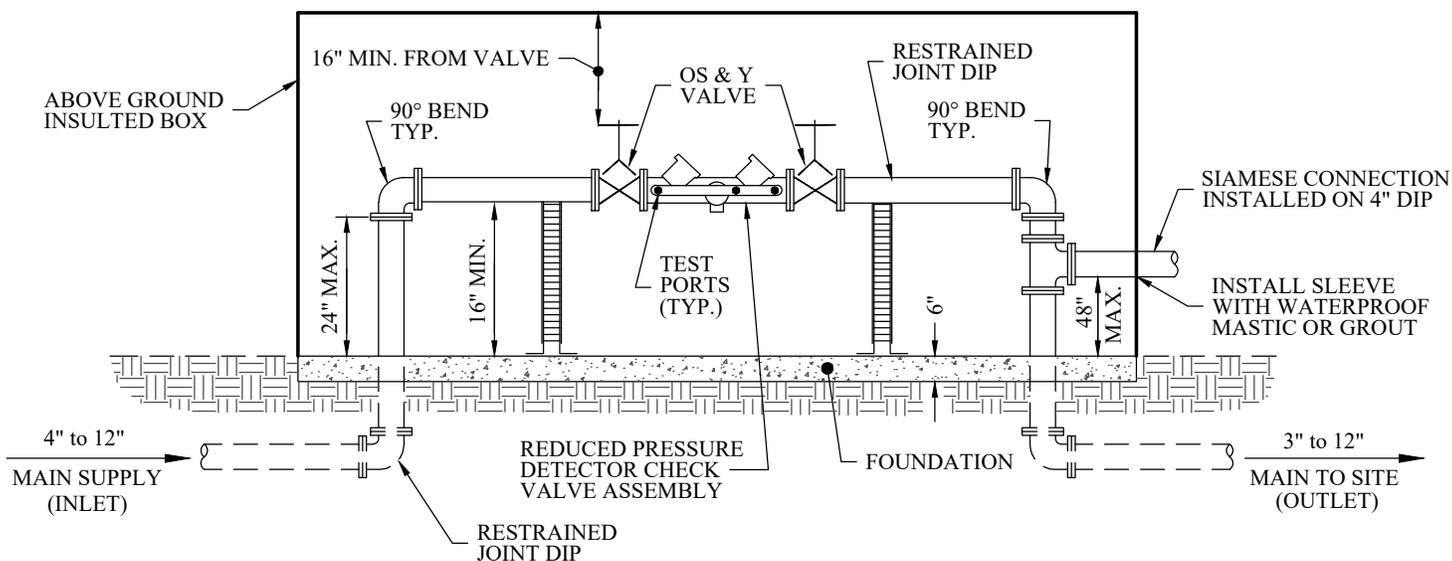

PROFILE VIEW

NOTE:
SEE DETAILS 5.6 & 5.7.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

APPROVED JAN. 2020

REVISED: JANUARY 2018

**REDUCED PRESSURE DETECTOR CHECK
VALVE ASSEMBLY FIRE LINE
ABOVE GROUND ENCLOSURE**
AUD DETAIL 1.20.4

AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901

