


MANHOLE RING AND COVER
SEE STANDARD SPECS.
AUD DETAIL 2.7.1 AND 2.7.2

NON-SHRINK
GROUT TYPICAL

ATTACH LOCATING WIRE
ABOVE FINISH GRADE
USING CLIP AND SCREW

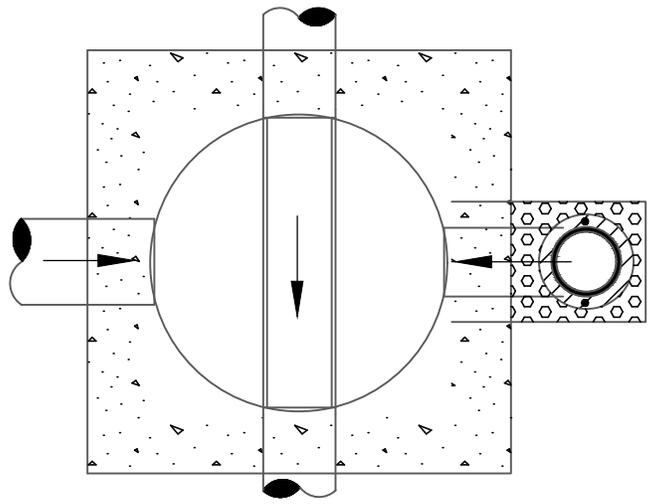

SECTION C-C

MANHOLE STEPS
SEE AUD DETAIL 3.5

STANDARD LOCATING WIRE
CONTINUOUS FROM MANHOLE TO MANHOLE

BRICK DAM NOT
LESS THAN $\frac{1}{3}D_2$

1 JOINT D.I.P. MINIMUM

PRECAST CONCRETE

DROP PIPE RJ TO BE
DUCTILE IRON OF NEXT
STD. SIZE SMALLER THAN
 D_2 6" MIN. (TYPICAL)

D.I.P. DROP TO BE
ENCASED IN #57 STONE

GREATER THAN 2'

6" TO 8" #57 GRADE
STONE

C

C

TYPICAL SECTION

NOTES:

1. NO MORE THAN 6" ADJUSTMENT BY RISERS ON RING AND COVER.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

APPROVED JAN. 2020

REVISED: JANUARY 2018

DROP MANHOLE

**AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901**

AUD DETAIL 2.4

