


WATER MAIN


CENTERED / RESTRAINED
POSITIONING FIELD LOK
REQUIRED



SANITARY SEWER

CENTERED / RESTRAINED
POSITIONING FIELD LOK
REQUIRED

PULL ON OR WRAP AROUND END SEALS OR
PRESSURE GROUTING. NO BRICK SHALL BE
ACCEPTED.

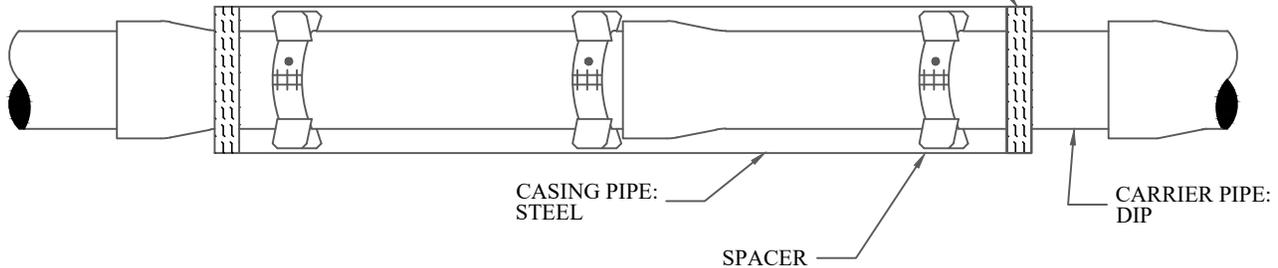

PROFILE VIEW

NOTES:

1. SPACERS SHALL BE AN 8" OR 12" WIDE BAND.
2. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S STANDARDS.
3. THICKNESS OF CASING PIPE SHALL BE IN ACCORDANCE WITH D.O.T. OR RAILWAY SPECIFICATIONS.
4. CASING PIPE SHALL EXTEND BEYOND THE EDGE OF PAVEMENT BY A MINIMUM OF 6 FEET. (AUD MAY REQ. LONGER CASING FOR DEEPER BORES BASED ON SOIL TYPE).
5. CARRIER PIPE TO BE LOK JOINTS.
6. CARRIER PIPE TO BE DIP

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT
PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

APPROVED JAN. 2020

REVISED: JANUARY 2018

**JACK AND BORE
(WATER AND SEWER MAINS)**

AUD DETAIL 3.1

**AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901**

