
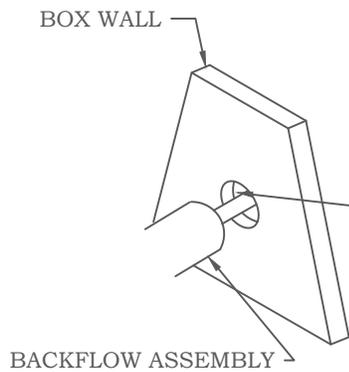



CARSON INDUSTRIAL SERIES 1015 BOX WITH COVER

(OR EQUIVALENT USED FOR ASSEMBLIES 1-1/4" AND SMALLER)

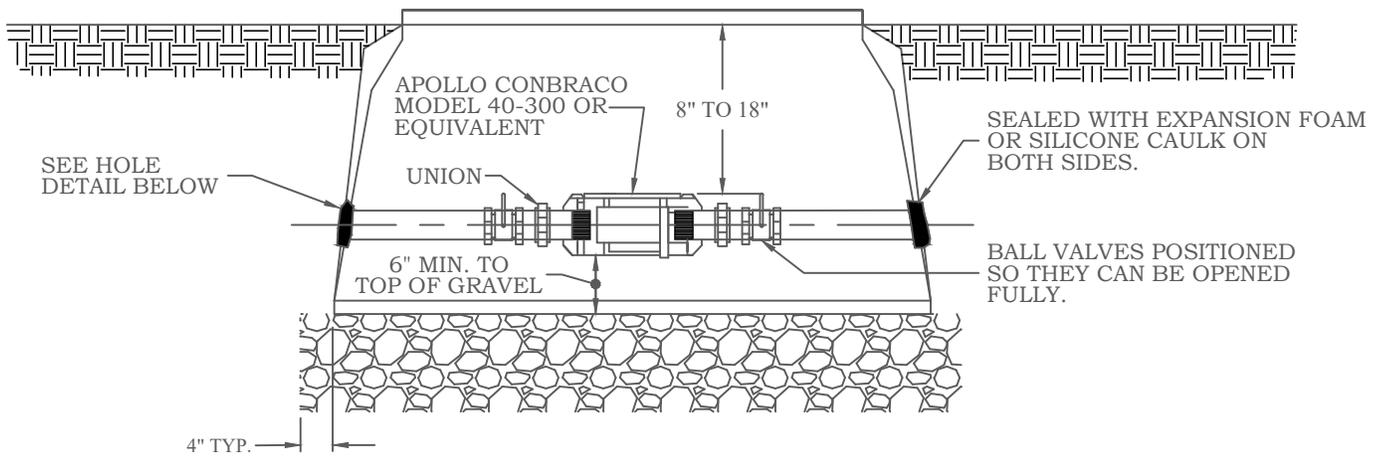

PIPE CUTOUT HOLES MUST
BE LARGER THAN THE WATER
LINE AND SEALED WITH EXPANSION
FOAM OR SILICONE CAULK
INSIDE AND OUTSIDE THE BOX
TO PREVENT DIRT AND WATER
FROM ENTERING THE BOX.

HOLE DETAIL INSIDE VIEW

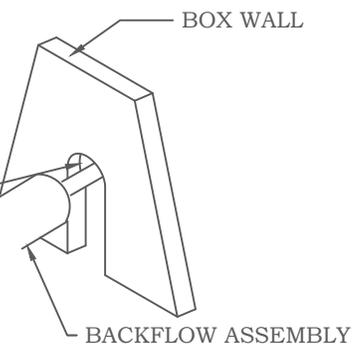

APPROVED JAN. 2020

REVISED: APRIL 2019

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT
PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

**RESIDENTIAL DUAL CHECK ASSEMBLY
INSTALLATION DETAIL**

AUD DETAIL 5.8

**AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901**

