


PLAN VIEW

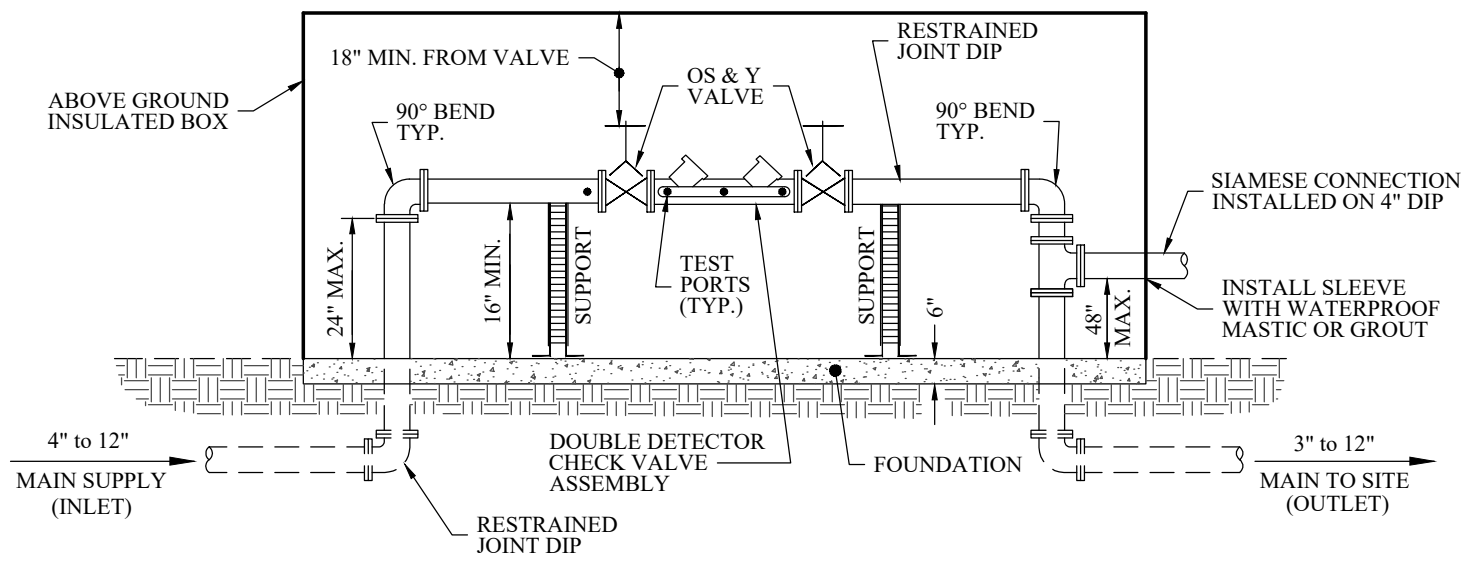

PROFILE VIEW

- NOTE:
1. ENSURE 18" MINIMUM DISTANCE IS CALCULATED FROM VALVE WHEEL TO TOP OF THE BOX.
 2. SEE DETAILS 1.22 & 1.23.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

APPROVED JAN. 2021

REVISED: JANUARY 2021

**DOUBLE DETECTOR CHECK VALVE
ASSEMBLY FIRE LINE
ABOVE GROUND ENCLOSURE
AUD DETAIL 1.27**

**AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901**

