


PLAN VIEW

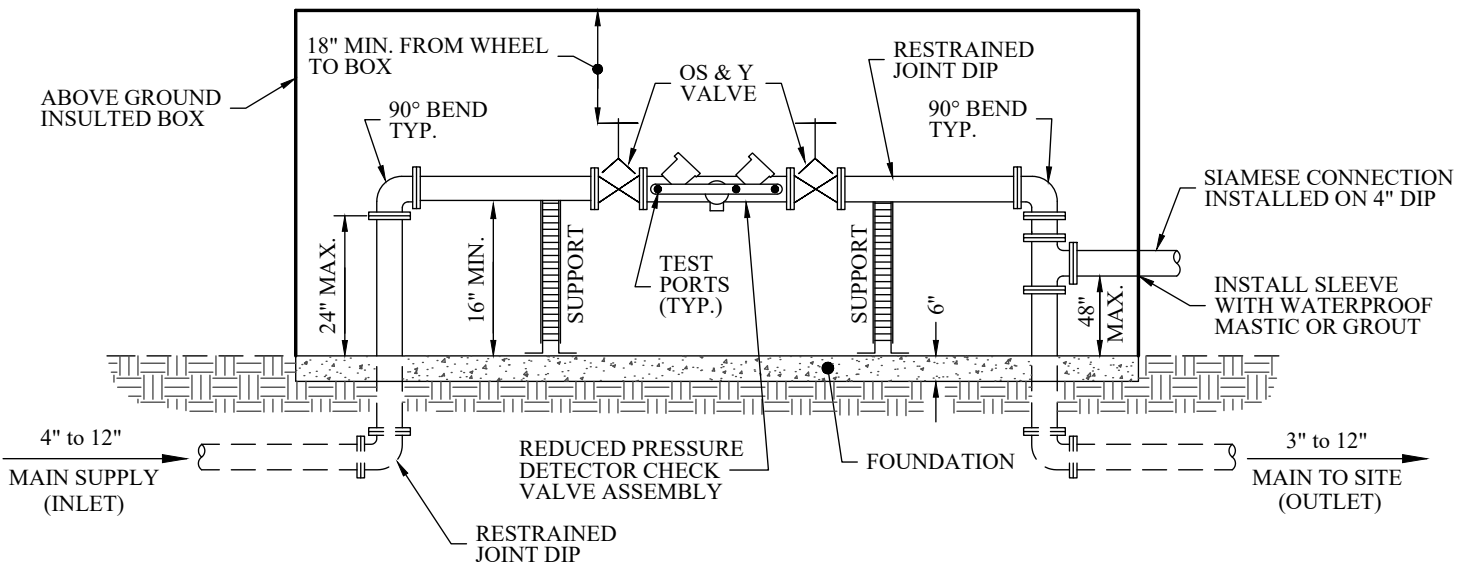

PROFILE VIEW

NOTE:
SEE DETAILS 1.22 & 1.23.


NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

APPROVED JAN. 2021

REVISED: JANUARY 2021

**REDUCED PRESSURE DETECTOR CHECK
VALVE ASSEMBLY FIRE LINE
ABOVE GROUND ENCLOSURE**

**AUGUSTA UTILITIES DEPARTMENT
452 WALKER STREET, SUITE 200
AUGUSTA, GA 30901**

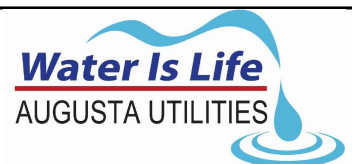

AUD DETAIL 1.28