


**WATER MAIN**


CENTERED / RESTRAINED  
POSITIONING FIELD LOK  
REQUIRED



**SANITARY SEWER**

CENTERED / RESTRAINED  
POSITIONING FIELD LOK  
REQUIRED

PULL ON OR WRAP AROUND END SEALS OR  
PRESSURE GROUTING. NO BRICK SHALL BE  
ACCEPTED.

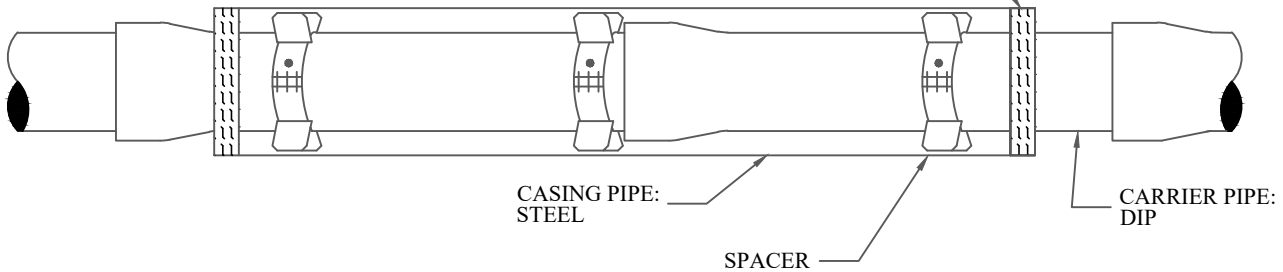

**PROFILE VIEW**

**NOTES:**

1. SPACERS SHALL BE AN 8" OR 12" WIDE BAND.
2. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S STANDARDS.
3. THICKNESS OF CASING PIPE SHALL BE IN ACCORDANCE WITH D.O.T. OR RAILWAY SPECIFICATIONS.
4. CASING PIPE SHALL EXTEND BEYOND THE EDGE OF PAVEMENT BY A MINIMUM OF 6 FEET. (AUD MAY REQ. LONGER CASING FOR DEEPER BORES BASED ON SOIL TYPE).
5. CARRIER PIPE TO BE LOK JOINTS.
6. CARRIER PIPE TO BE DIP

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT  
PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

**APPROVED JAN. 2021**

REVISED: JANUARY 2021

**JACK AND BORE  
(WATER AND SEWER MAINS)**

**AUD DETAIL 3.5**

**AUGUSTA UTILITIES DEPARTMENT  
452 WALKER STREET, SUITE 200  
AUGUSTA, GA 30901**

