


LANE POLYPROPYLENE VAULT LADDER WITH PULL-UP HANDRAIL ACCESS LADDER
 PRECAST CONCRETE VAULT - MINIMUM 6" WALLS, TOP SLAB AND FLOOR

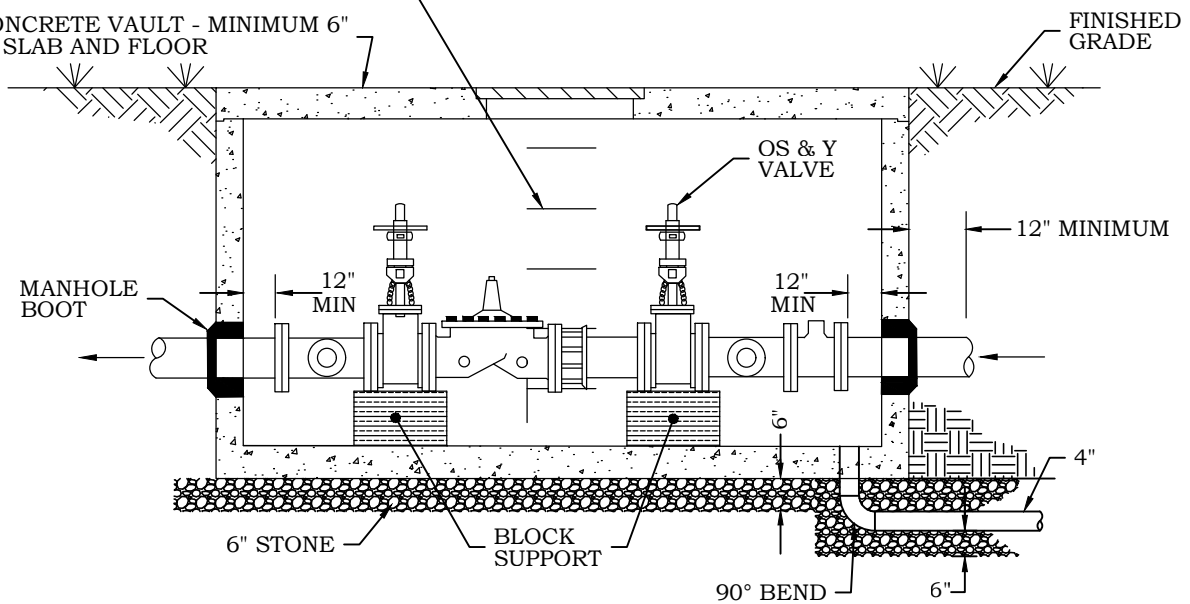

NOTES


1. ALL FITTINGS AND PIPE IN VAULT TO BE FLANGED D.I. CLASS 52.
2. ACCESS DOOR SHALL BE HALLIDAY PRODUCTS OR OUR APPROVED EQUAL
 - A) IN NON-TRAFFIC AREA - MODEL NO. S1R3636
 - B) IN TRAFFIC AREA - MODEL NO. H1R3636
3. PRESSURE REDUCING VALVES SHALL BE ROSS VALVES OR APPROVED EQUAL .
4. VAULTS IN TRAFFIC AREAS SHALL BE H-20 LOAD RATED.
5. REFERENCES TO ALL OIL FILLED GAUGES SHALL BE UP TO 200 PSI.

NO REVISION OR MODIFICATION OF THIS DETAIL SHALL BE MADE WITHOUT PRIOR WRITTEN APPROVAL FROM AUGUSTA UTILITIES DEPARTMENT.

REVISED: JANUARY 2018

PRESSURE REDUCING VALVE VAULT

AUGUSTA UTILITIES DEPARTMENT
 452 WALKER STREET, SUITE 200
 AUGUSTA, GA 30901

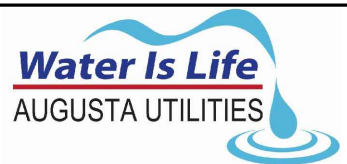

AUD DETAIL 1.23